


DRY-WELL SIZE REQUIREMENTS				
NET IMPERVIOUS AREA	# OF TANKS REQUIRED	DEPTH (D) (FT)	WIDTH (W) (FT)	LENGTH (L) (FT)
200 - 500 SQ FT	1	4	4	6
501 - 1000 SQ FT	2	4	6	8
1001 - 1500 SQ FT	3	4	6	12
1501 - 2000 SQ FT	4	4	8	12

1. SITES WITH LESS THAN 200 SQ FT OF ADDITIONAL IMPERVIOUS AREA DO NOT NEED TO ADDRESS DETENTION.
2. SITES WITH MORE THAN 2,000 SQ FT OF ADDITIONAL IMPERVIOUS AREA WILL REQUIRE ADDITIONAL DESIGN.

## DRY WELL GRAVEL TRENCH INSTALLATION


N.T.S.

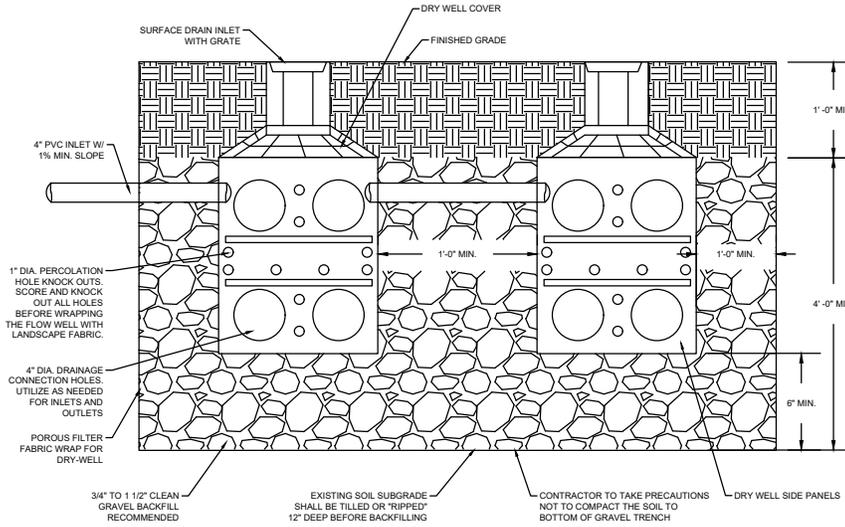

1. DEPTH OF THE GRAVEL BACKFILL BENEATH THE DRY WELL: 0.5'
2. THE THICKNESS OF THE GRAVEL BACKFILL AROUND THE DRY-WELL: 1'
3. TOTAL VOLUME OF WATER TO BE STORED: SEE TABLE
4. DRY-WELL SHALL BE A MINIMUM OF 10 FEET FROM ANY STRUCTURE.
5. INSTALL PER MANUFACTURER'S SPECIFICATIONS

## DRY WELL DETAIL (TANKS IN A LINE)

N.T.S.

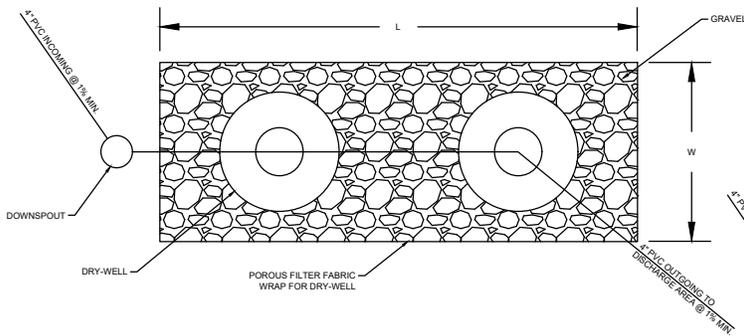

## DRY WELL DETAIL (4 TANKS SQUARE CONFIGUTATION)

N.T.S.

